

## Sound Absorption Coefficient ISO 354

### Measurement of absorption in reverberation rooms

**Client** kvadrat  
**Test Specimen** Curtains Flat

#### Mounting type G-100

One layer of textile  
 Textile: Keiga from Kvadrat

#### Test Build-Up (from top to bottom):

1.8 mm Front textile  
 100 mm Air gap  
 Reflective wall

#### Mounting


100mm distance to the wall  
 Flat curtains 3 elements: 2x 1420x3010mm + 1x 1180x3010mm  
 Total dimensions of the test object  
 L x H = 3980mm x 3010mm

**Room:** Reverberation Room  
**Volume:** 156 m<sup>3</sup>  
**Size:** 11.98 m<sup>2</sup>  
**Date of test** 15/10/2025



Frequency [Hz]	$\alpha_s$ 1/3 octave	$\alpha_p$ octave
100	0.03	
125	0.03	0.05
160	0.11	
200	0.17	
250	0.22	0.25
315	0.31	
400	0.43	
500	0.52	0.55
630	0.64	
800	0.73	
1000	0.75	0.70
1260	0.62	
1600	0.51	
2000	0.57	0.60
2500	0.65	
3160	0.62	
4000	0.66	0.65
5000	0.69	

#### Sound Absorption Coefficient $\alpha$

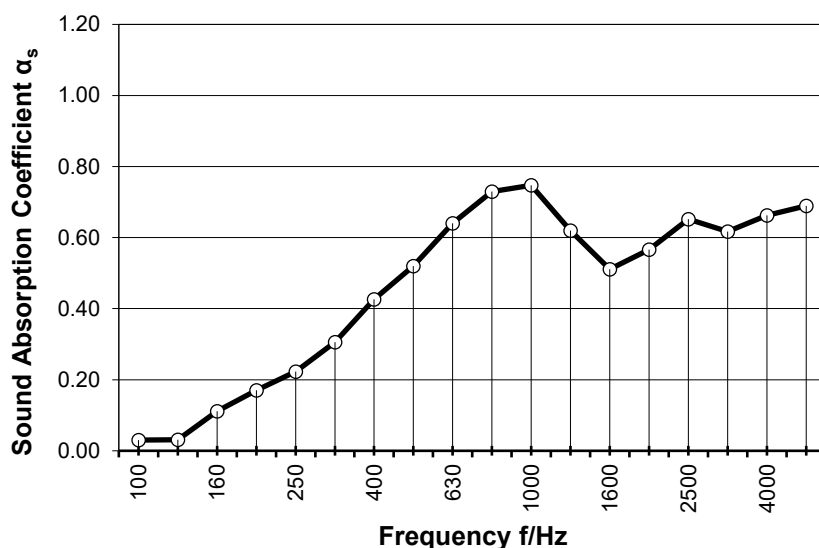

$\alpha_s$  Sound absorption coefficient to ISO 354

$\alpha_p$  Practical sound absorption coefficient to ISO 11654

<b>NRC:</b>	<b>0.50</b>
<b>SAA:</b>	<b>0.51</b>

Rating according to ISO 11654:

**Weighted Sound Absorption Coefficient  $\alpha_w = 0.55$**

Sound absorption class: D

## Sound Absorption Coefficient ISO 354

### Measurement of absorption in reverberation rooms

**Client** Kvadrat  
**Test Specimen** Curtains Folded 100%

**Mounting type G-100**

One layer of textile

Textile: Keiga from Kvadrat

**Test Build-Up (from top to bottom):**

1.8 mm Front textile  
 100 mm Air gap  
 Reflective wall

**Mounting**


100mm distance to the wall  
 1 layer of curtains, 5 elements 1420x3010mm with approx. 20mm overlap, 100% folded, 200% textile length  
 Total dimensions of the test object  
 L x H = 3510mm x 3010mm

**Room:** Reverberation Room  
**Volume:** 156 m<sup>3</sup>  
**Size:** 10.57 m<sup>2</sup>  
**Date of test** 15/10/2025



Frequency [Hz]	$\alpha_s$ 1/3 octave	$\alpha_p$ octave
100	0.19	
125	0.17	0.25
160	0.41	
200	0.48	
250	0.59	0.55
315	0.64	
400	0.73	
500	0.76	0.75
630	0.79	
800	0.81	
1000	0.82	0.80
1260	0.84	
1600	0.85	
2000	0.87	0.85
2500	0.88	
3160	0.87	
4000	0.91	0.90
5000	0.95	

**Sound Absorption Coefficient  $\alpha$**

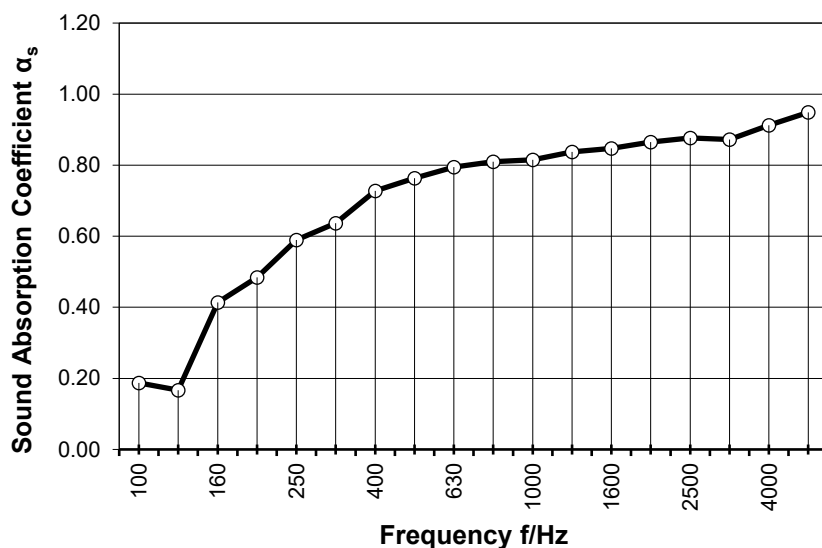

$\alpha_s$  Sound absorption coefficient to ISO 354  
 $\alpha_p$  Practical sound absorption coefficient to ISO 11654

<b>NRC:</b>	<b>0.75</b>
<b>SAA:</b>	<b>0.75</b>

Rating according to ISO 11654:

**Weighted Sound Absorption Coefficient  $\alpha_w = 0.8$**

Sound absorption class:B

## Sound Absorption Coefficient ISO 354

### Measurement of absorption in reverberation rooms

**Client** kvadrat  
**Test Specimen** Curtains Flat

#### Mounting type G-150

One layer of textile  
 Textile: Keiga from Kvadrat

#### Test Build-Up (from top to bottom):

1.8 mm Front textile  
 150 mm Air gap  
 Reflective wall

#### Mounting


150mm distance to the wall  
 Flat curtains 3 elements: 2x 1420x3010mm + 1x 1180x3010mm  
 Total dimensions of the test object  
 L x H = 3980mm x 3010mm

Room: Reverberation Room  
 Volume: 156 m<sup>3</sup>  
 Size: 11.98 m<sup>2</sup>  
 Date of test 15/10/2025



Frequency [Hz]	$\alpha_s$ 1/3 octave	$\alpha_p$ octave
100	0.06	
125	0.06	0.10
160	0.18	
200	0.24	
250	0.31	0.35
315	0.43	
400	0.55	
500	0.63	0.65
630	0.70	
800	0.69	
1000	0.53	0.55
1260	0.48	
1600	0.59	
2000	0.60	0.60
2500	0.60	
3160	0.64	
4000	0.67	0.65
5000	0.70	

#### Sound Absorption Coefficient $\alpha$

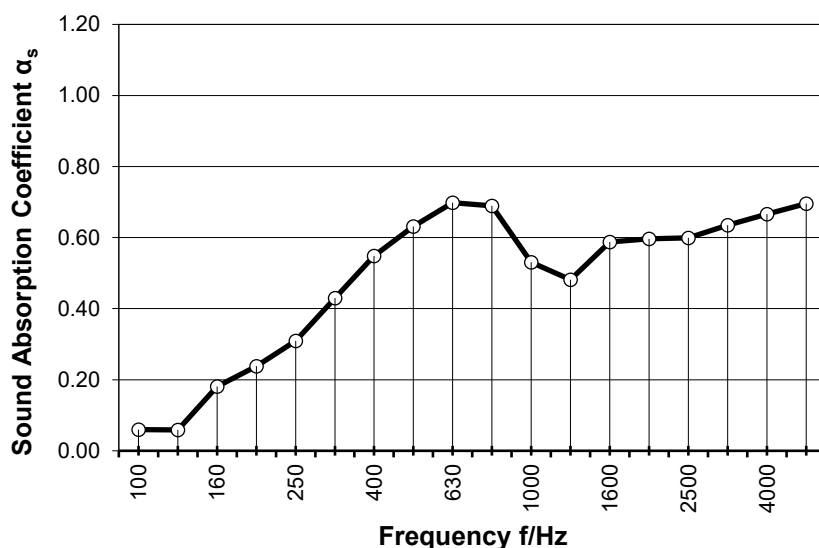

$\alpha_s$  Sound absorption coefficient to ISO 354  
 $\alpha_p$  Practical sound absorption coefficient to ISO 11654

<b>NRC:</b>	<b>0.55</b>
<b>SAA:</b>	<b>0.53</b>

Rating according to ISO 11654:

**Weighted Sound Absorption Coefficient  $\alpha_w = 0.6$**

Sound absorption class: C

## Sound Absorption Coefficient ISO 354

### Measurement of absorption in reverberation rooms

**Client** Kvadrat  
**Test Specimen** Curtains Folded 100%

**Mounting type G-150**

One layer of textile

Textile: Keiga from Kvadrat

**Test Build-Up (from top to bottom):**

1.8 mm Front textile  
 150 mm Air gap  
 Reflective wall


**Mounting**

150mm distance to the wall  
 1 layer of curtains, 5 elements 1420x3010mm with approx. 20mm overlap, 100% folded, 200% textile length  
 Total dimensions of the test object  
 L x H = 3510mm x 3010mm

**Room:** Reverberation Room  
**Volume:** 156 m<sup>3</sup>  
**Size:** 10.57 m<sup>2</sup>  
**Date of test** 15/10/2025



Frequency [Hz]	$\alpha_s$ 1/3 octave	$\alpha_p$ octave
100	0.21	
125	0.19	0.30
160	0.46	
200	0.53	
250	0.65	0.60
315	0.68	
400	0.76	
500	0.77	0.75
630	0.79	
800	0.80	
1000	0.82	0.80
1260	0.84	
1600	0.84	
2000	0.85	0.85
2500	0.88	
3160	0.89	
4000	0.91	0.90
5000	0.95	

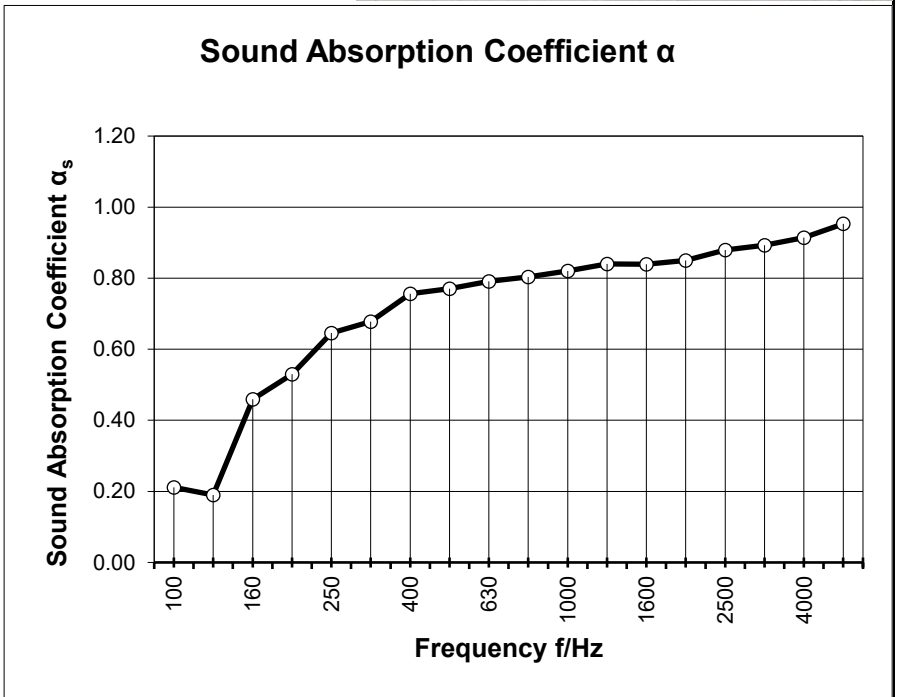

$\alpha_s$  Sound absorption coefficient to ISO 354  
 $\alpha_p$  Practical sound absorption coefficient to ISO 11654

<b>NRC:</b>	<b>0.75</b>
<b>SAA:</b>	<b>0.77</b>

Rating according to ISO 11654:

**Weighted Sound Absorption Coefficient  $\alpha_w = 0.8$**

Sound absorption class: B