

# Sound Absorption Coefficient ISO 354

Measurement of absorption in reverberation rooms

**Client** Kinnasand

**Test Specimen** Curtains

Flat

**Wall mounting - 100mm distance**

One layer of textile

Textile: Dive from Kinnasand  
100% Polyester FR colour: 22

**Test Build-Up (from top to bottom):**

1 mm Front textile  
100 mm Air gap  
Reflective wall

**Mounting**

100mm distance to the wall

Flat curtains 1 element 4000x2700mm

Total dimensions of the test object

L x H = 4000mm x 2700mm



Room: Reverberation Room

Volume: 156 m<sup>3</sup>

Size: 10.80 m<sup>2</sup>


Date of test 20-11-19

Frequency [Hz]	$\alpha_s$ 1/3 octave	$\alpha_p$ octave
100	0.01	
125	0.01	0.00
160	0.01	
200	0.02	
250	0.01	0.00
315	0.01	
400	0.02	
500	0.02	0.05
630	0.03	
800	0.03	
1000	0.04	0.05
1260	0.03	
1600	0.03	
2000	0.03	0.05
2500	0.04	
3160	0.04	
4000	0.04	0.05
5000	0.05	

$\alpha_s$  Sound absorption coefficient to ISO 354

$\alpha_p$  Practical sound absorption coefficient to ISO 11654

Rating according to ISO 11654:

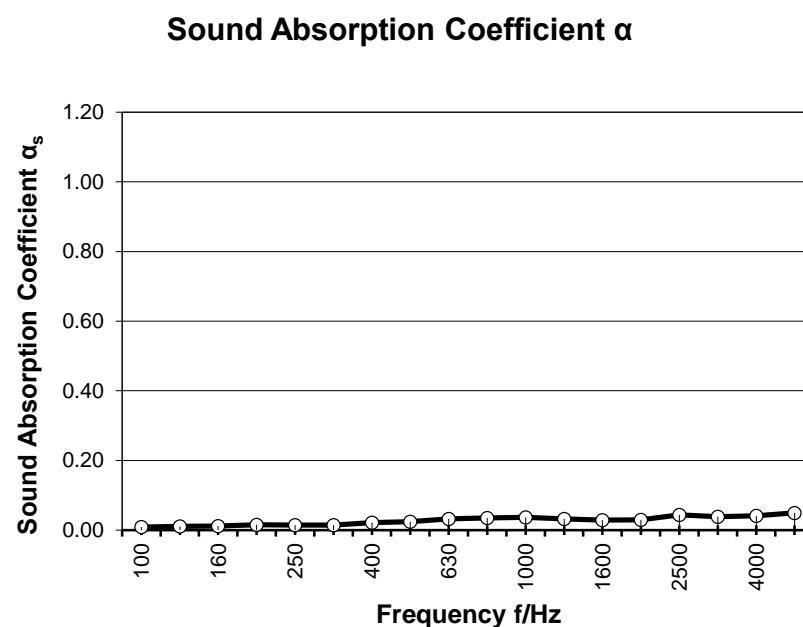

NRC:	0.05
SAA:	0.03

**Weighted Sound Absorption Coefficient  $\alpha_w = 0.05$**

Sound absorption class:-

# Sound Absorption Coefficient ISO 354

Measurement of absorption in reverberation rooms

**Client** Kinnasand

**Test Specimen** Curtains

Folded 100%

**Wall mounting with 100mm distance**

One layer of textile

Textile: Dive from Kinnasand colour: 22  
100% Polyester FR

**Test Build-Up (from top to bottom):**

1 mm	Front textile
100 mm	Air gap
	Reflective wall

**Mounting**

100mm distance to the wall

1 layer of curtains, 2 elements 4000x2700mm with approx.

20mm overlap, 100% folded, 200% textile length

Total dimensions of the test object

L x H = 3980mm x 2700mm




Room: Reverberation Room

Volume: 156 m<sup>3</sup>

Size: 10.75 m<sup>2</sup>

Date of test 20-11-19

Frequency [Hz]	as 1/3 octave	ap octave
100	0.03	
125	0.05	0.05
160	0.04	
200	0.04	
250	0.05	0.05
315	0.05	
400	0.05	
500	0.05	0.05
630	0.06	
800	0.05	
1000	0.05	0.05
1260	0.06	
1600	0.07	
2000	0.07	0.05
2500	0.08	
3160	0.09	
4000	0.09	0.10
5000	0.10	

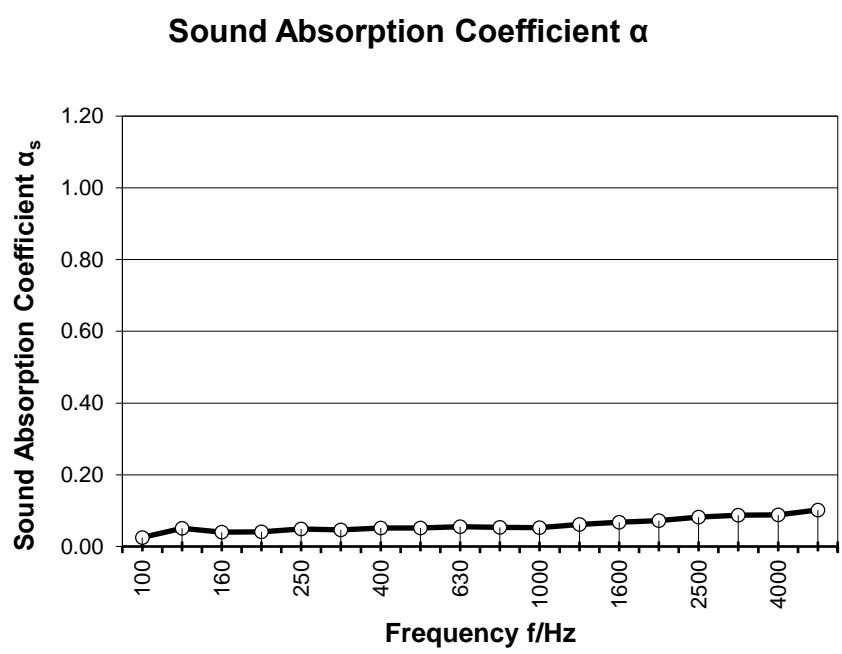

as Sound absorption coefficient to ISO 354

ap Practical sound absorption coefficient to ISO 11654

Rating according to ISO 11654:

NRC:	0.05
SAA:	0.06

**Weighted Sound Absorption Coefficient  $\alpha_w = 0.05$**

Sound absorption class:-

**kvadrat soft cells**

Test conducted by Kvadrat SoftCells  
Poznańska 3, 62-023 Gądko